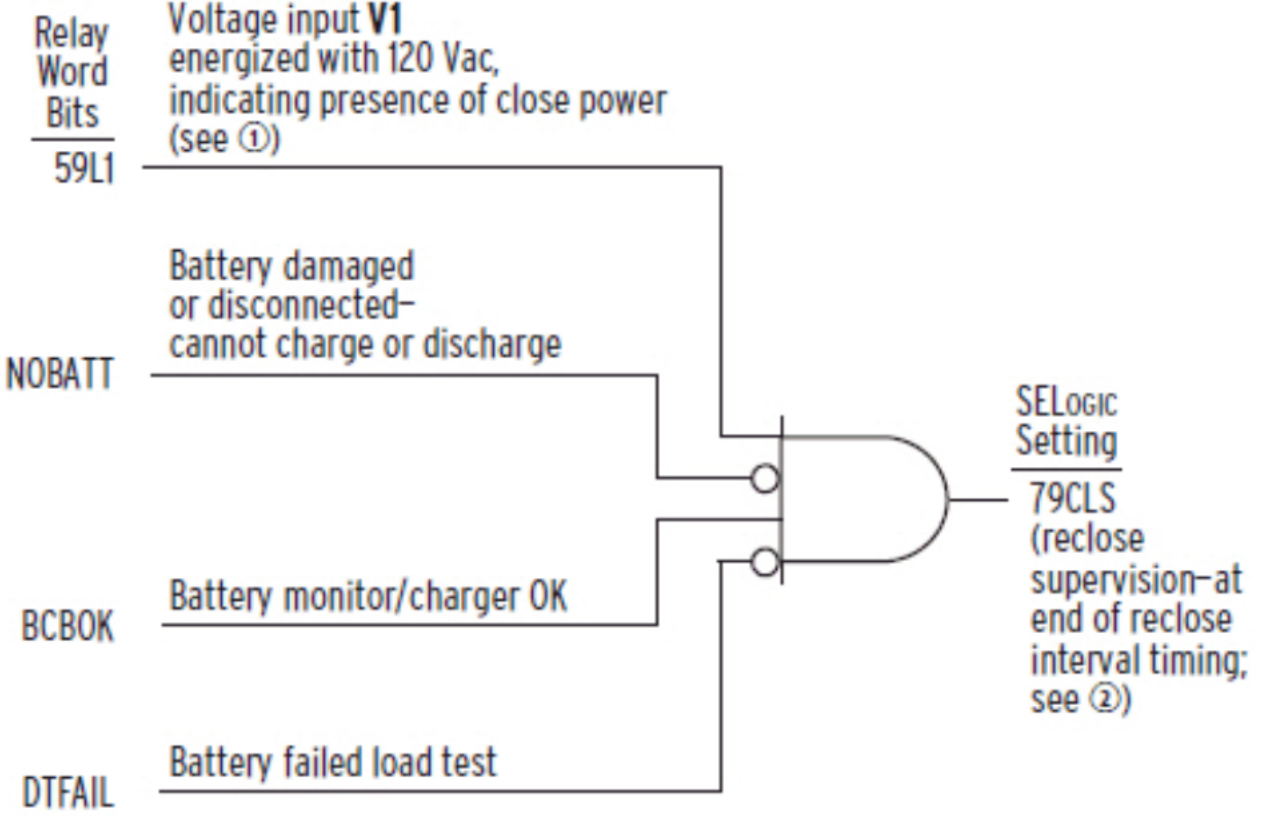
Relay Word Bits
59L1
Voltage input V1 energized with 120 Vac, indicating presence of close power (see ①)
NOBATT
Battery damaged or disconnected–cannot charge or discharge
BCBOK
Battery monitor/charger OK
DTFAIL
Battery failed load test
SELOGIC Setting
79CLS (reclose supervision–at end of reclose interval timing; see ②)